


## XLC 300 - Standard version - Technical details



N.	Component	Standard material	Optional
1	Body	ductile cast iron GJS 500-7 or GJS 450-10	
2	Cap	ductile cast iron GJS 500-7 or GJS 450-10	
3	Position indicator	s.s. AISI 303 (nickel-plated brass for DN 400)	stainless steel AISI 303
4	Pressure outlet taps	stainless steel AISI 316	
5	Upper flat O-ring	NBR	EPDM/Viton
6	Obturator O-ring	NBR	EPDM/Viton
7	Indicator stem	stainless steel AISI 303	stainless steel AISI 316
8	Main shaft	stainless steel AISI 303	stainless steel AISI 316
9	Guide ring	bronze CuSn5Zn5Pb5	stainless s. AISI 304/316
10	Spring	stainless steel AISI 302	
11	Locking nut	stainless steel AISI 304	stainless steel AISI 316
12	Upper flat	painted steel	stainless s. AISI 304/316
13	Diaphragm	polyamide-Nylon	neoprene/EPDM-Nylon
14	Obturator	AISI 303 (DN 80), p. steel, duct. c. iron (from DN 200)	stainless s. AISI 304/316
15	Plane gasket	NBR	
16	Gasket holder	stainless steel AISI 303 (304 from DN 200)	stainless steel AISI 316
17	Seat	stainless steel AISI 303 (316 from DN 200)	stainless steel AISI 316
18	Seat O-ring	NBR	EPDM/Viton
19	Studs	stainless steel AISI 304	stainless steel AISI 316
20	Nuts and washers	stainless steel AISI 304	stainless steel AISI 316

The list of materials and components is subject to changes without notice.

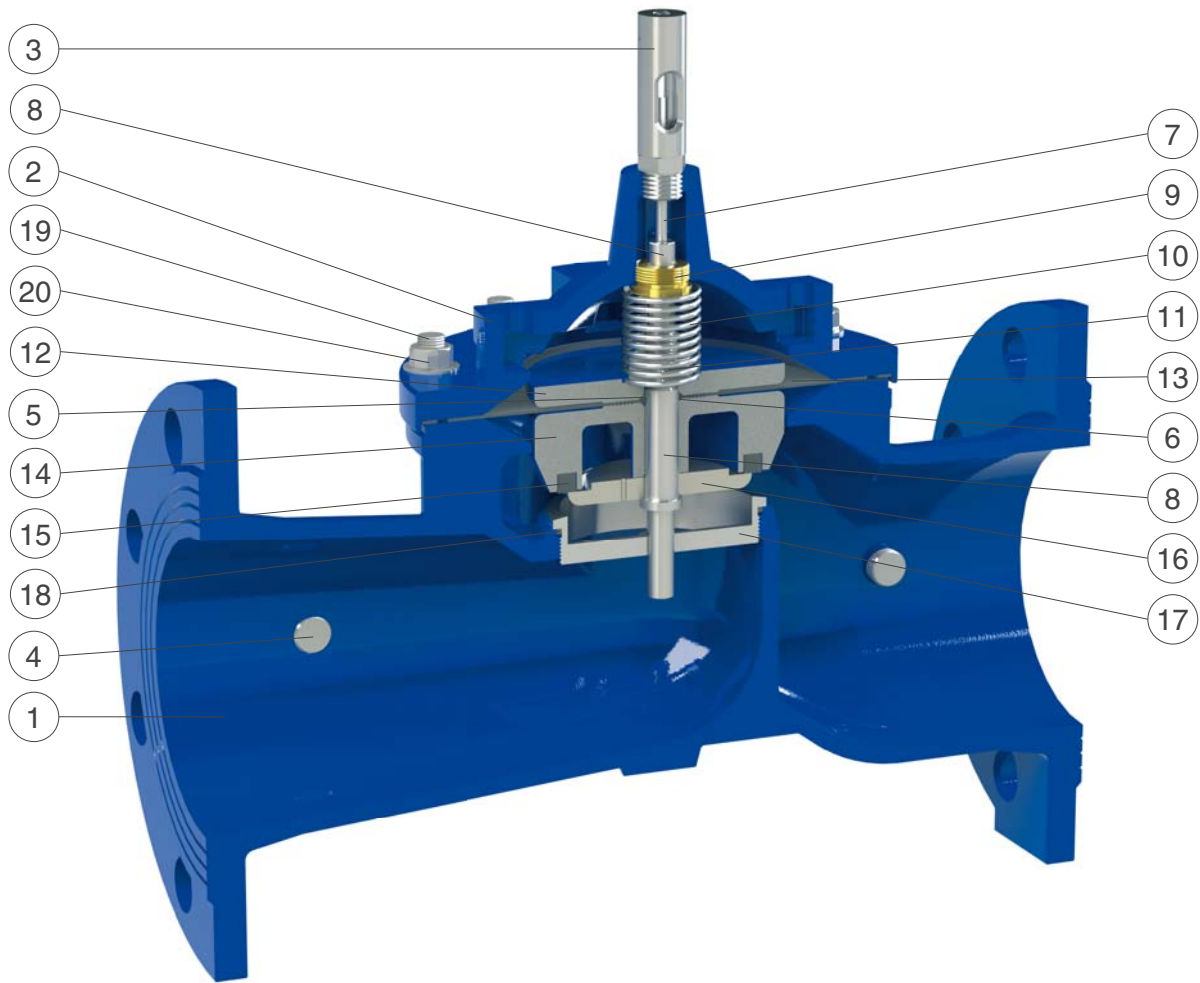

## XLC 300 - Standard version - Technical data

DN (mm)	80	100	125	150	200	250	300	400	500	600
Kv (m³/h)	54	118	187	198	487	802	1256	1742	3089	3236
Stroke (mm)	15	21	27	27	43	56	70	84	110	110

### Head loss coefficient


Kv coefficient representing the flow rate which is flowing through the valve fully open, and producing a head loss of 1 bar.

### Cavitation chart

The cavitation analysis is very important since it may lead to substantial damages, in addition to vibration and noise. The cavitation chart has to be used to determine whether the working point obtained by the intersection of the lines, connecting upstream (y axis) and downstream (x axis) pressure conditions, lies within one of the 3 zones to be identified as follows:


- A: Recommended working conditions;
- B: Noise cavitation;
- C: Damage cavitation.

The chart is to be used for valves modulating with an opening percentage between 35-40% at standard water temperature and elevation below 300 m. For continuous pressure reduction the maximum allowed  $\Delta p$  shall not exceed 15 bar.

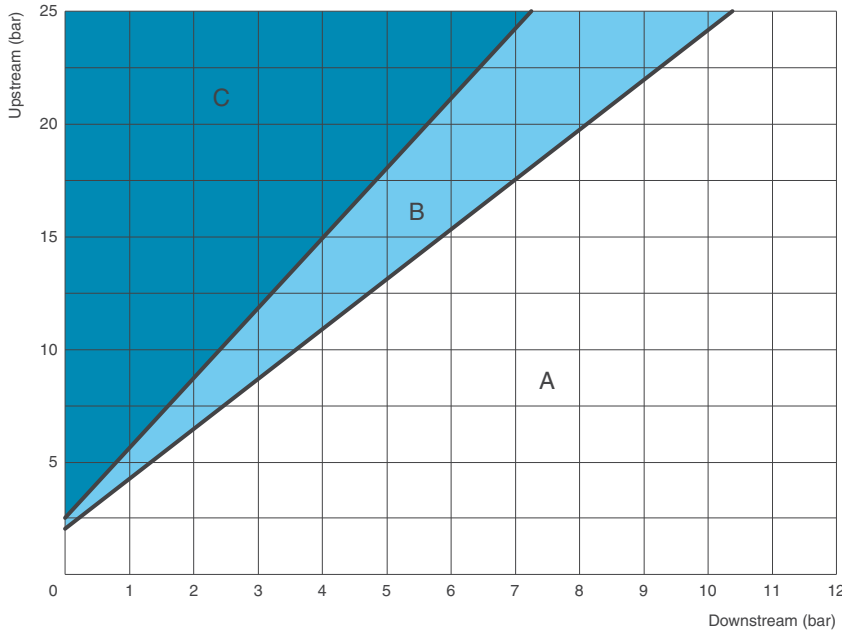

### Head loss chart

The chart indicates the head loss of XLC 300 automatic control valves fully open versus flow rate in l/s.

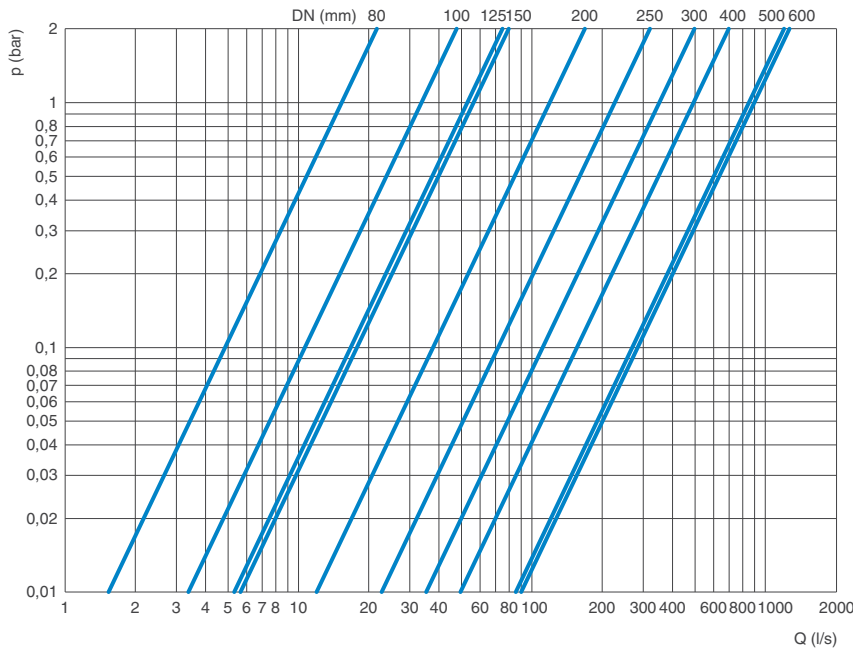

### Recommended flow rate

The following chart shows the recommended flow rate for the proper sizing of XLC 300 control valves.


DN (mm)			80	100	125	150	200	250	300	400	500	600
Flow rate (l/s)	Low head loss (0,1-0,15 bar)	Max.	4,7	10	16	17	36	70	110	153	271	284
		Min.	1,0	2,5	3,9	4,1	8,8	16	25	35	63	63
	Recommended	Max.	11	29	43	45	101	180	274	406	695	728
		Max.	15	38	59	62	132	235	368	530	942	942

All values are approximate, consult CSA service for more details.

## XLC 300 - Standard and anti-cavitation versions - Technical data

### Kv to valve opening chart

The following chart shows the opening percentage of XLC 300, XLC 300-AC and XLC 300-CP versus the Kv.

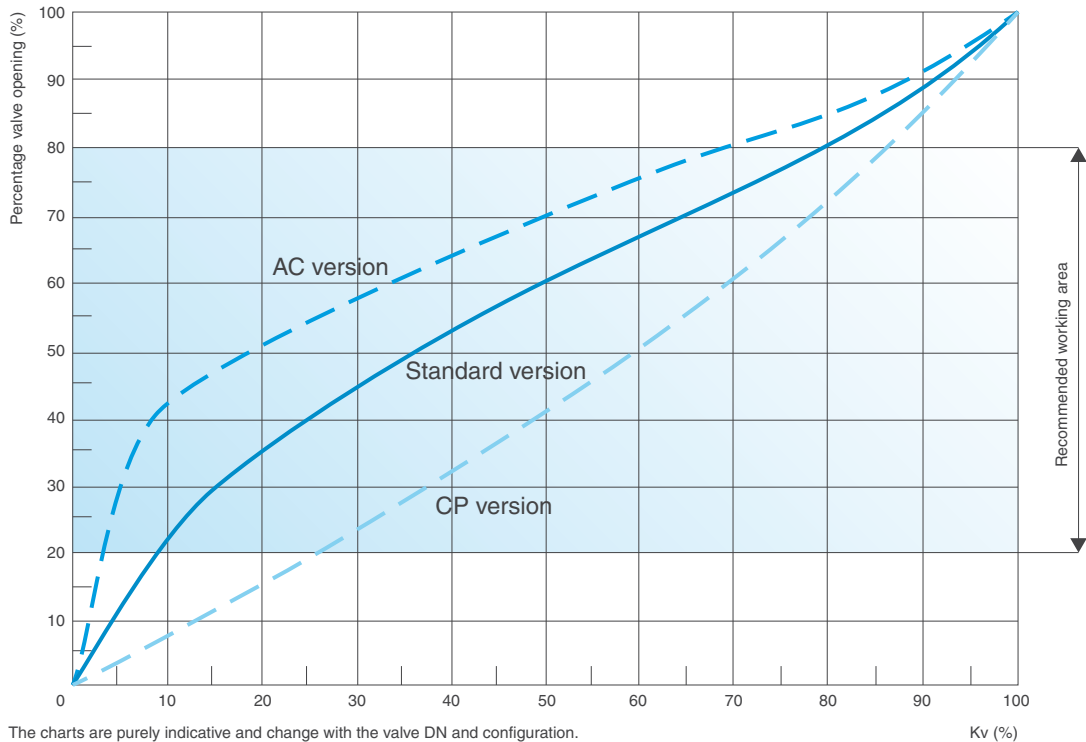

### Working conditions


Treated filtered water.  
 Maximum temperature: 70°C.  
 Minimum pressure on the pilot : 0,5 bar plus head loss.  
 Maximum pressure : 25 bar.

### Standard

Certified and tested in compliance with EN 1074/5.  
 Pressure rating 25 bar.  
 Flanges according to EN 1092/2 (different drilling on request).  
 Epoxy painting applied through FBT technology blue RAL 5005.

### Weights and dimensions

DN (mm)	A (mm)	B (mm)	C (mm)	D (mm)	E (mm)	Weight (Kg)
80	310	162	100	245	30	24
100	350	218	118	280	30	34
125	400	260	135	350	30	47
150	480	260	150	350	30	54
200	600	370	180	460	30	97
250	730	444	213	515	40	172
300	850	570	242	605	40	304
400	1100	680	310	745	40	480
500	1250	870	365	945	40	782
600	1450	870	423	970	40	922

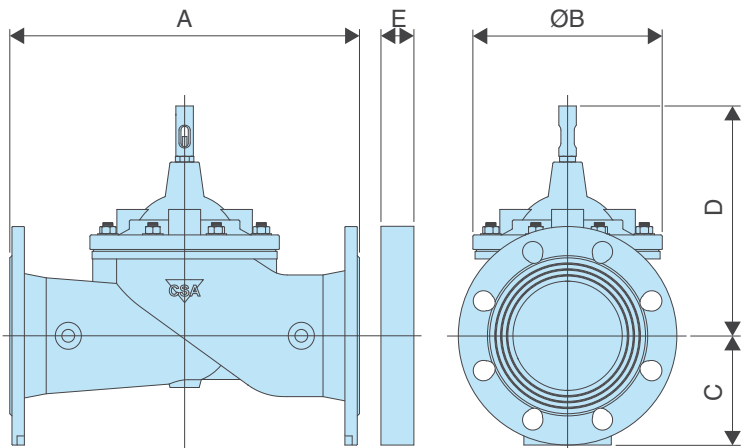

The dimension E in the picture above refers only to applications where it is necessary to add a flanged orifice downstream or upstream of the valve, for example for flow control or cavitation prevention.

All values are approximate, consult CSA service for more details.

## XLC 300 - Standard and anti-cavitation versions - Spare parts breakdown

